



Efficient and cost effective method to reduce damaging motor bearing currents in big inverter drive systems

presented at PCIM 2005, Nuremberg, June 8



Hans Joachim Pöss, MAGNETEC GmbH


## The phenomenon

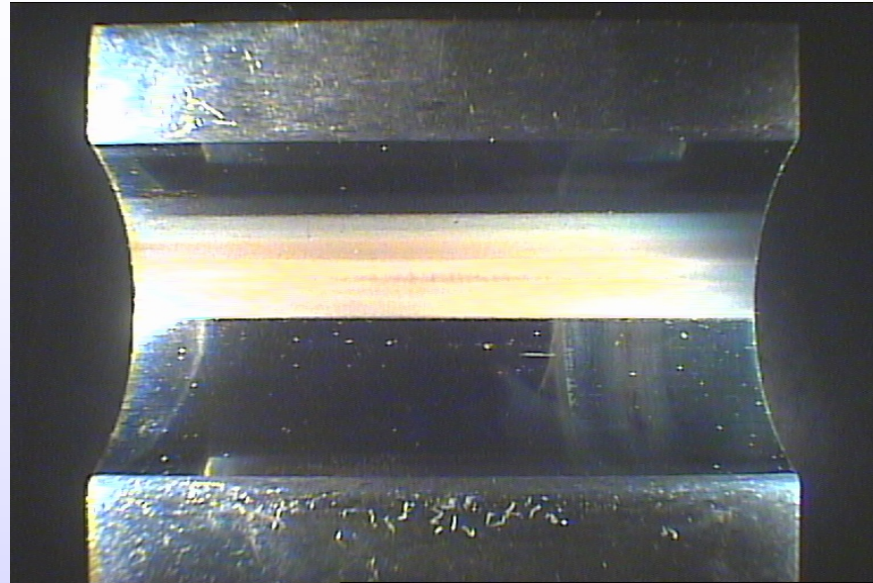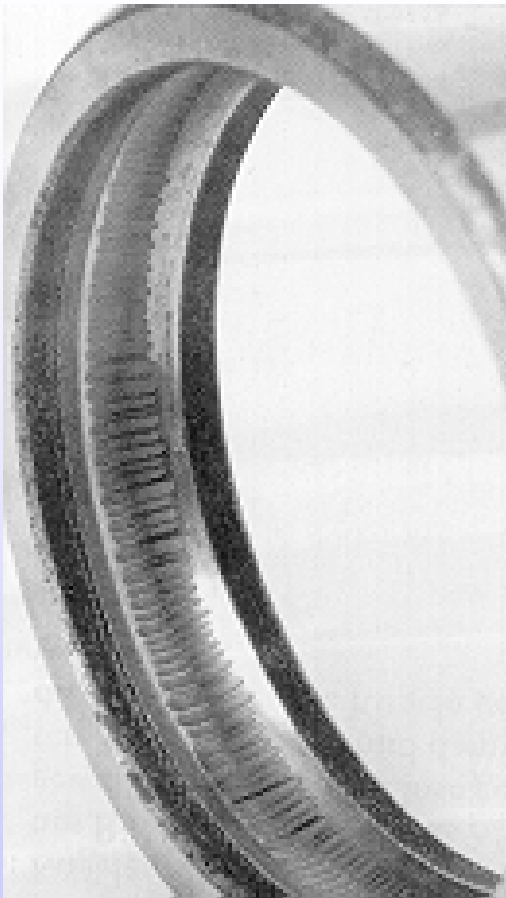

Motor bearing damages


**Cool Blue®** cores to reduce motor bearing voltages and -currents

## how can you measure the voltage across a bearing?

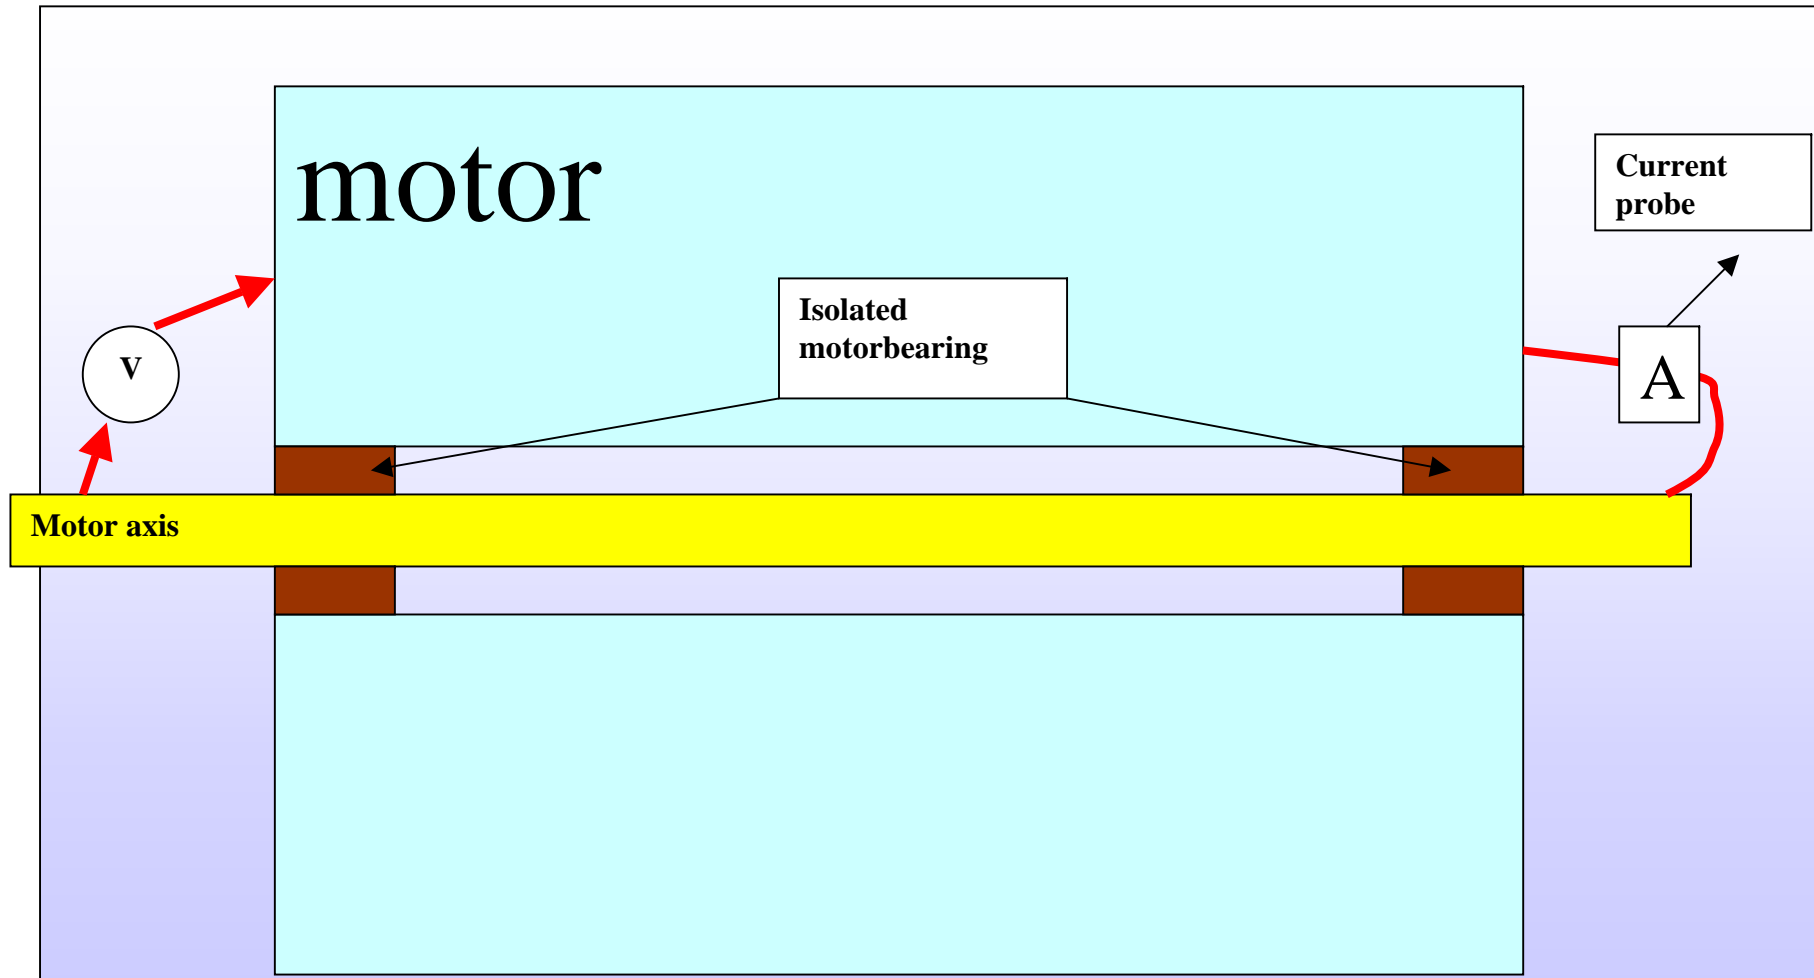


**Cool Blue®** cores to reduce motor bearing voltages and -currents

## Effect even on Isolated bearings

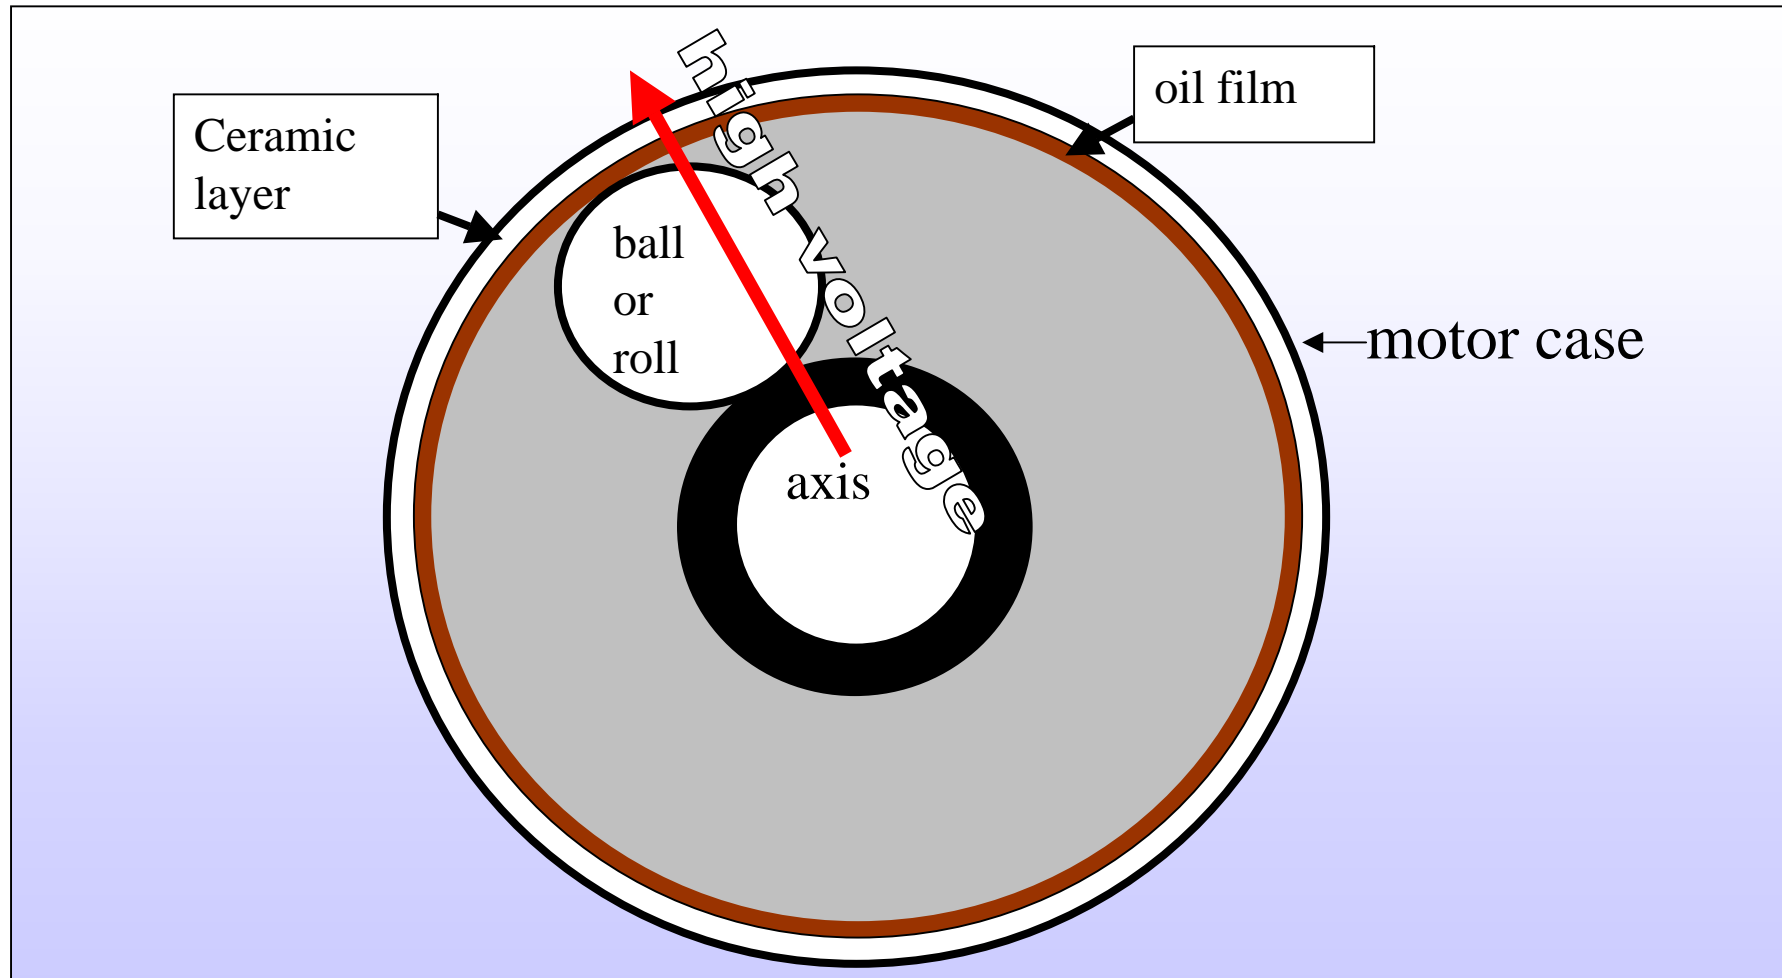


**Cool Blue®** cores to reduce motor bearing voltages and -currents

## Ceramic bearing and oil film short cut

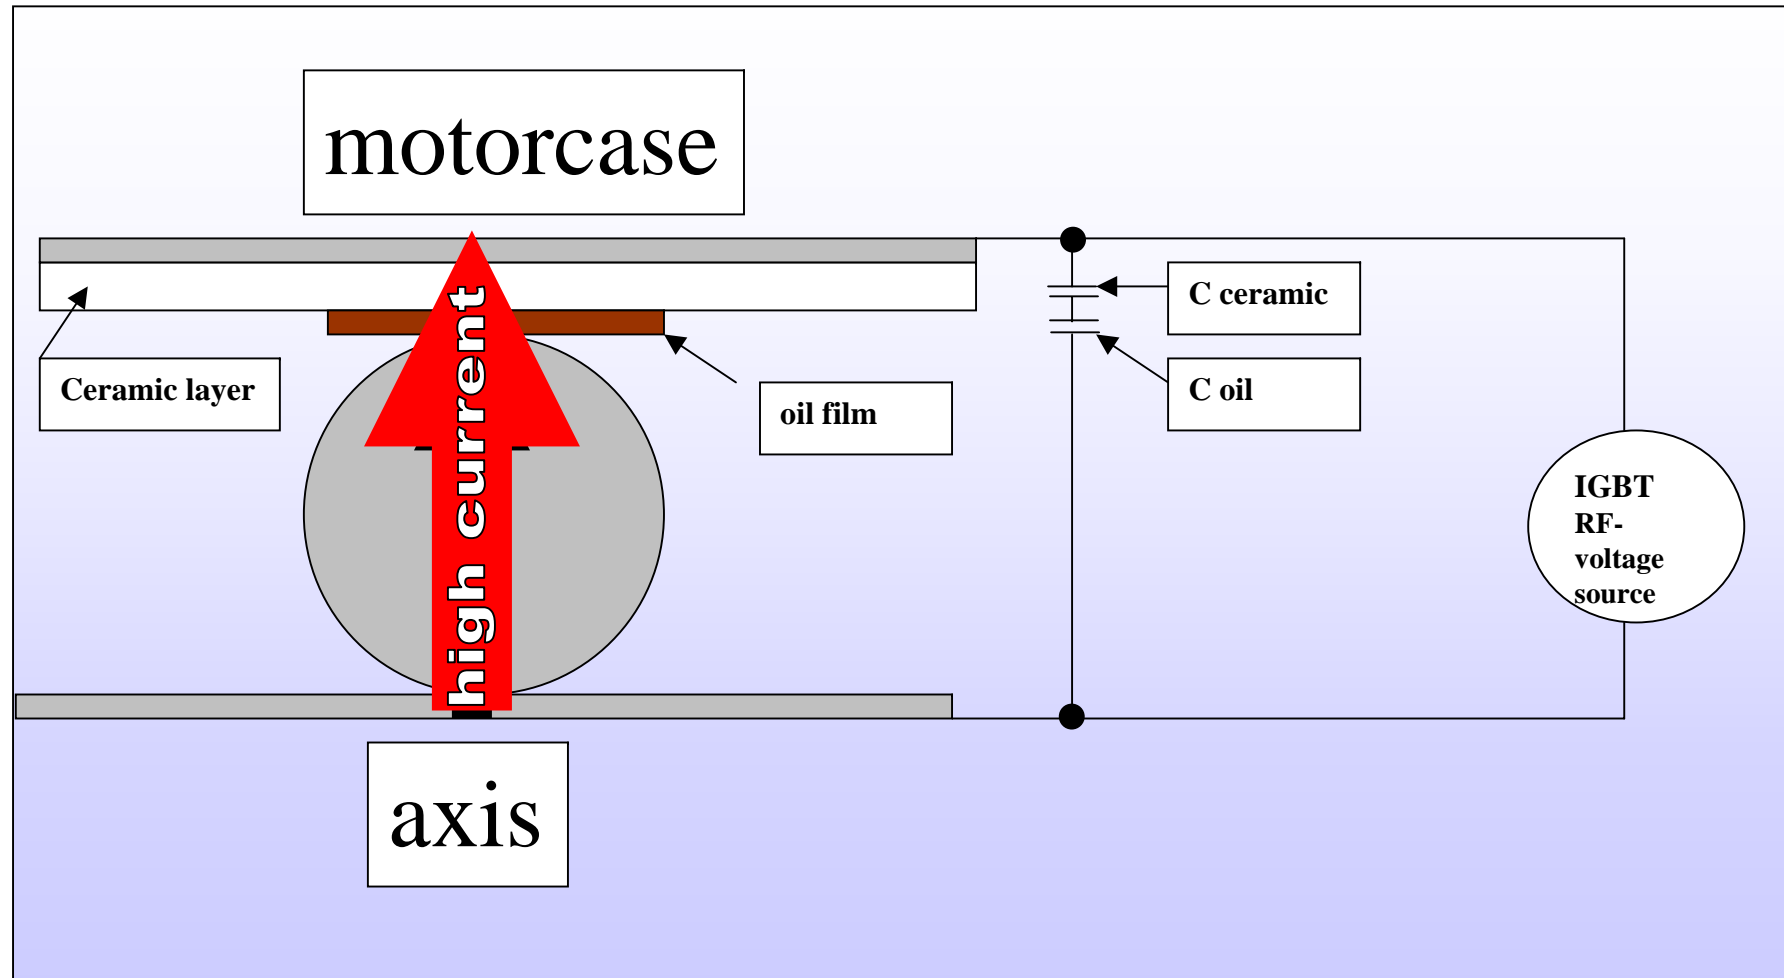

**Cool Blue®** cores to reduce motor bearing voltages and -currents

## How can we avoid these damaging currents ?

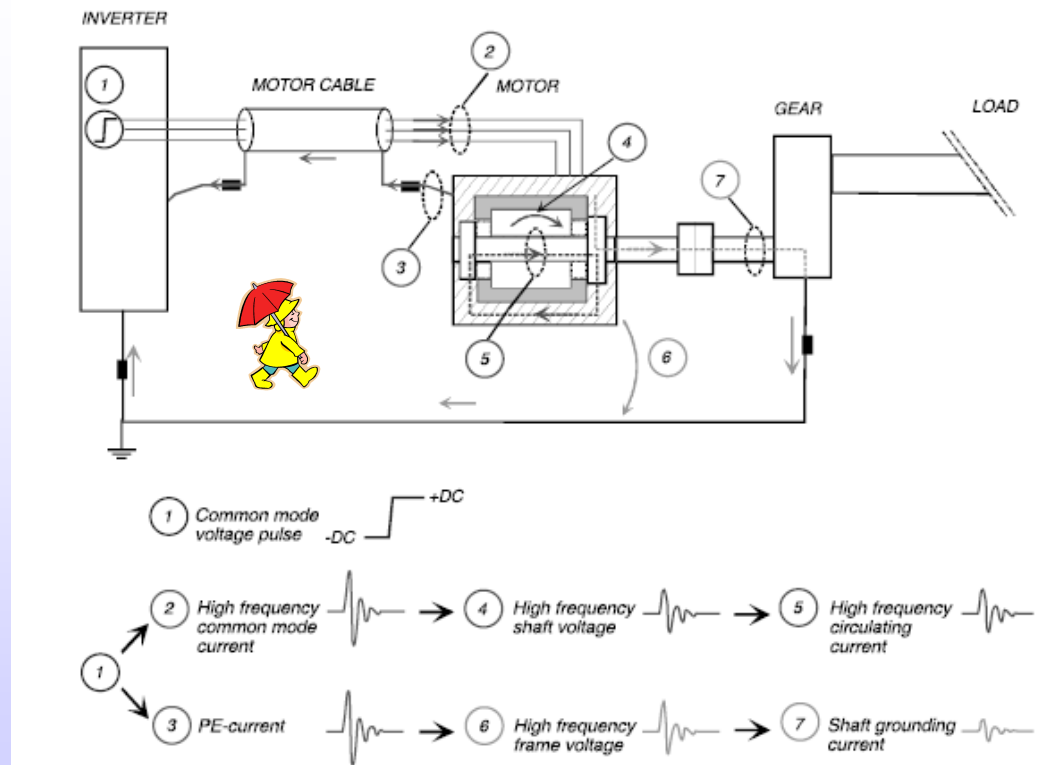

**Cool Blue®** cores to reduce motor bearing voltages and -currents

## A view inside the motor



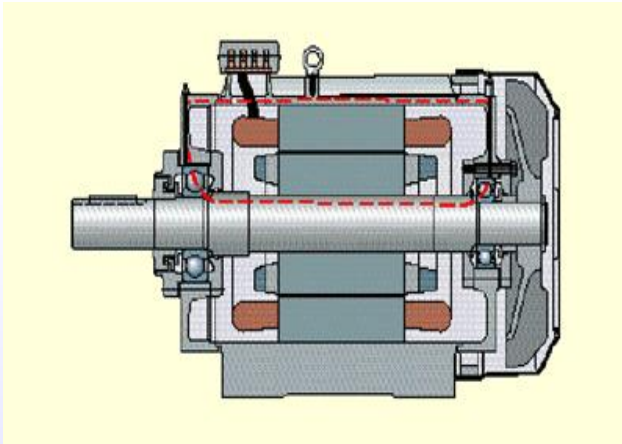



Figure 1: Bearing currents can cause "bearing fluting", a rhythmic pattern on the bearing's races.

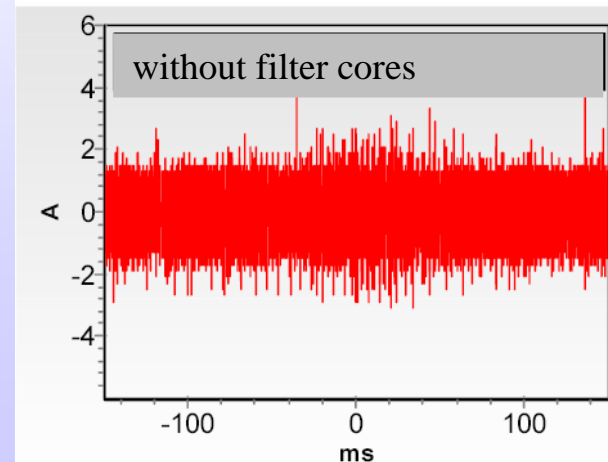


**Cool Blue®** cores to reduce motor bearing voltages and -currents

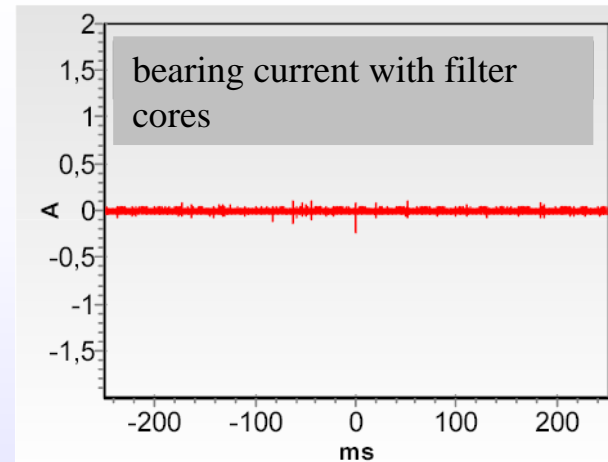


## Different solutions are possible

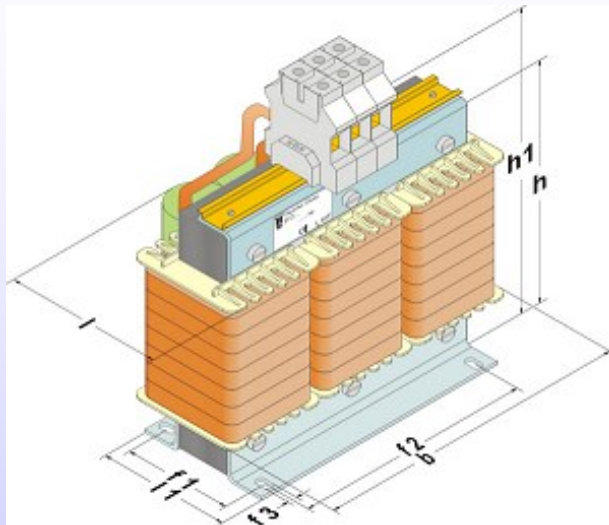

3-phase motor filter

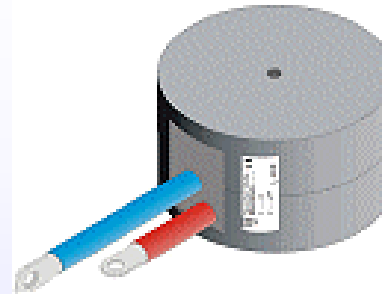

pot cores

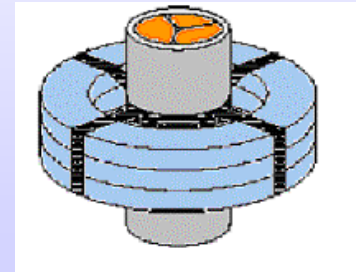

Cool Blue®-cores

**Cool Blue®** cores to reduce motor bearing voltages and -currents




## Why do **Cool Blue**® provide the best solution ?


- low to no noise operation
- low leakage field
- low loss / cool operation
- small volume
- easy to mount
- can easily be re-tooled
- very good value for the money

**Cool Blue**® cores to reduce motor bearing voltages and -currents

## How to use Cool Blue<sup>®</sup> cores made of NANOPERM<sup>®</sup>

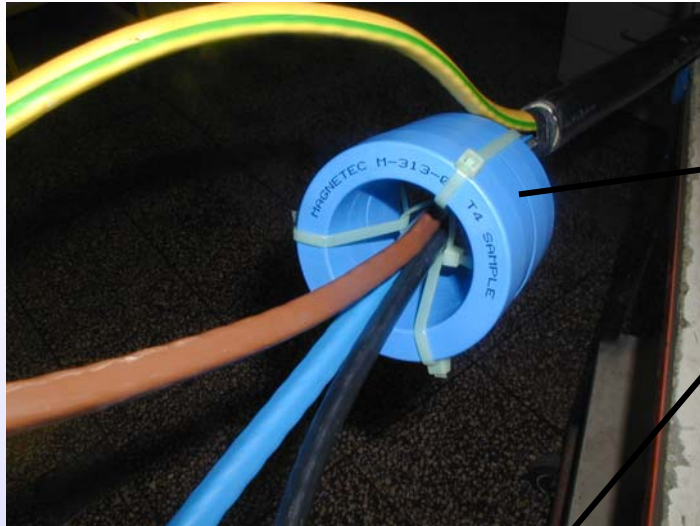


place core here,  
cover all wires  
but NOT the  
shielding (neural)

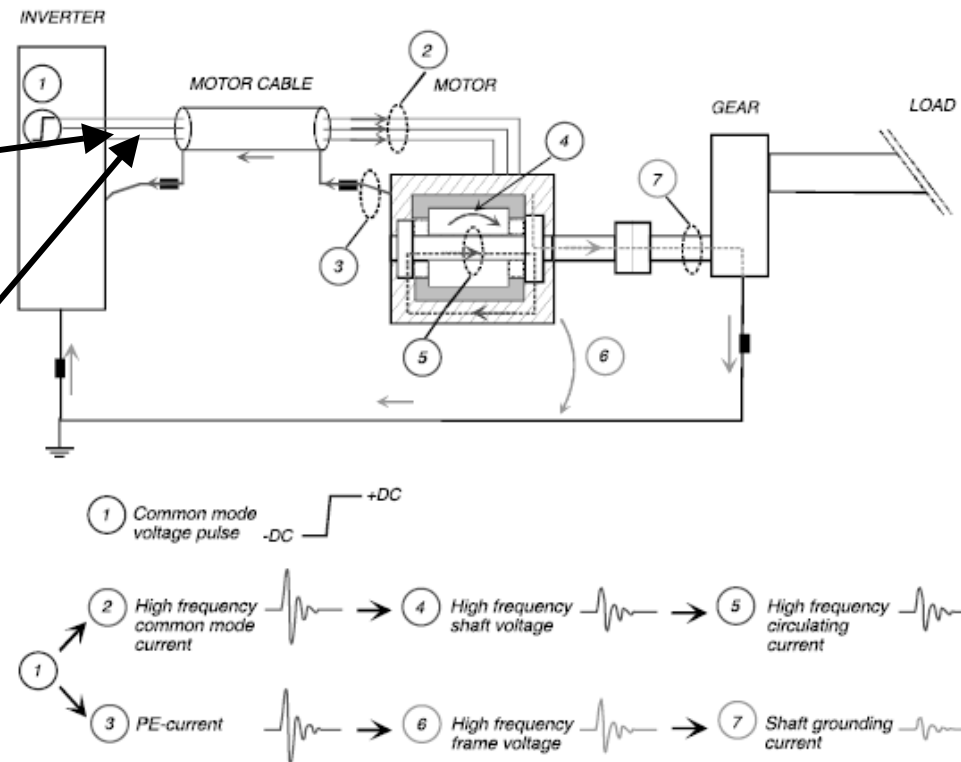

Cool Blue<sup>®</sup> cores to reduce motor bearing voltages and -currents


## How to use **Cool Blue**® cores made of **NANOPERM**®

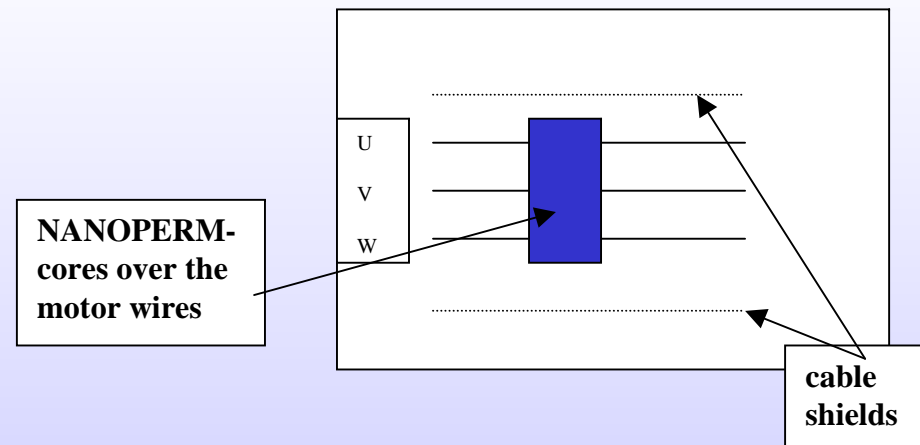

Cores operate as a common mode choke when being put over all motor cables

**Cool Blue**® cores to reduce motor bearing voltages and -currents

## How to derive the right Setup of cores?

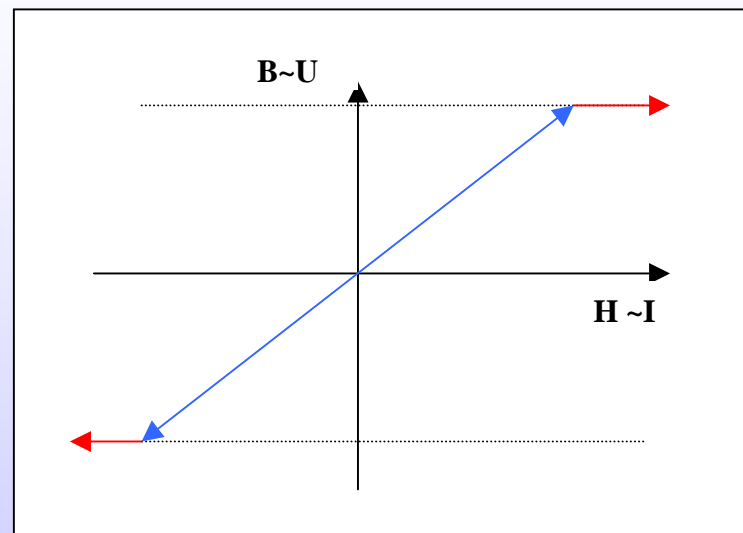


$H \sim I$   
Relate to the  
sum current  
 $L1+L2+L3$

$B \sim U$   
Relate to the  
inducted  
voltage in  
the core

The amount of cores necessary depends on the sum-bearing current

**Cool Blue®** cores to reduce motor bearing voltages and -currents

## Experimental approach

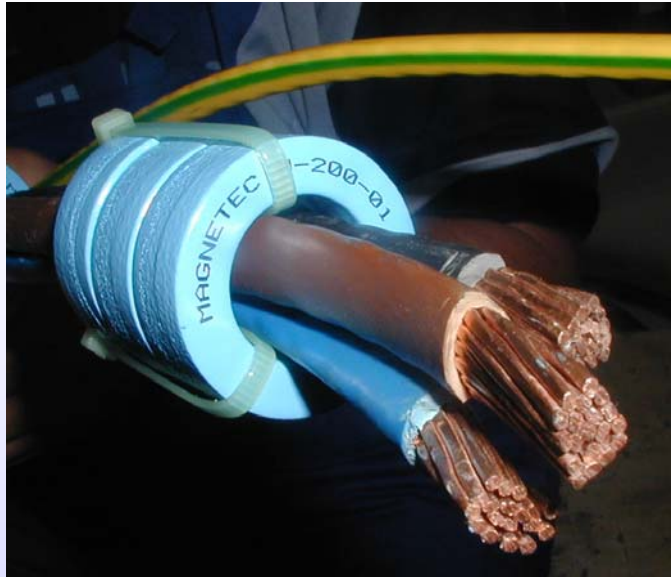

The inner diameter is defined by the cross section of the motor cables

3-4 cores should be mounted together

If the core temperature is  $> 120^{\circ}\text{C}$  double the amount of cores

If the temperature is still  $> 120^{\circ}\text{C}$  select next bigger core size

**Cool Blue<sup>®</sup>** cores to reduce motor bearing voltages and -currents

## Available round core standard range

Outer diameter	Inner diameter	h	Order no. p/n	max. asymmetric current (sum-current Peak)
80 mm	63	30	M-113	6 A
100	80	30	M-114	8 A
130	100	30	M-115	9 A
160	130	30	M-116	12 A
200	175	30	M-117	16 A
300	250	30	M-205	23 A

- More core types are available on request
- 4 pieces are typically necessary

**Cool Blue®** cores to reduce motor bearing voltages and -currents

## Available oval core standard range

Outer diameter	Inner diameter	h	Order no.	max. asymmetric current (sum-current Peak)
80 mm	63	30	M-283	6 A
100	80	30	M-284	8 A
130	100	20	M-142	9 A
160	130	30	M-116	12 A
240	200	30	M-111	19 A
300	250	30	M-248	23 A

- More core types are available on request
- 4 pieces are typically necessary

**Cool Blue®** cores to reduce motor bearing voltages and -currents



Motor bearing currents occur not only in Mega Watt – drives !

In MW-drives the switching frequencies are at around 1 kHz

In kW-drives the switching frequencies are in the 10 kHz range !

This causes motor bearing problems, too!

**Cool Blue®** cores to reduce motor bearing voltages and -currents

## Conclusion

**Cool Blue**<sup>®</sup> cores can increase motor bearing's lifetime up to factors compared to the actual standard.

Example:

A standstill in a paper factory for replacing the motor bearing costs about 10k€ per hour.

The investment of some 100 € is a worthwhile maintenance measure - it will double the bearing's lifetime!

**Cool Blue**<sup>®</sup> cores to reduce motor bearing voltages and -currents

## More informtion

available at:

[www.coolbluecores.com](http://www.coolbluecores.com)

visit our booth at **hall 12 -525**

**Thank you for your time !**

**Cool Blue®** cores to reduce motor bearing voltages and -currents